


PROFILE

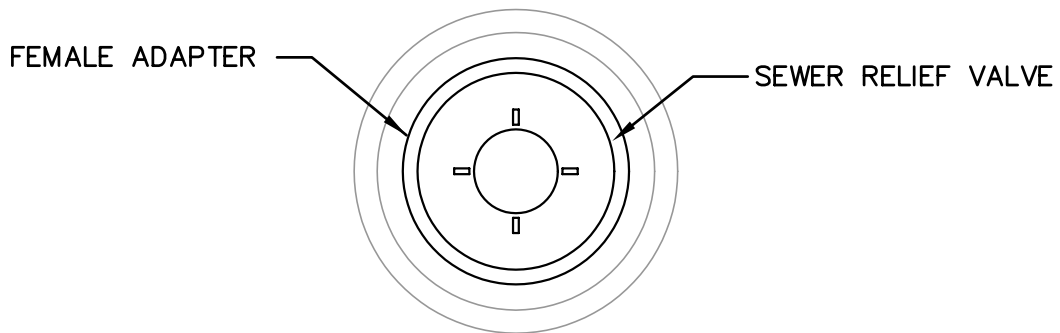

PLAN

NOTES:

- 1) THE SEWER RELEASE VALVE SHALL BE THE SAME SIZE AS THE LATERAL SEWER IT SERVICES.
- 2) COVERS SHALL BE C.I. FOR STREETS, ALLEYS OR DRIVES, OTHERWISE FIBRELYTE OR CONCRETE FOR NON-TRAFFIC USE.
- 3) A SEWER RELIEF VALVE MUST BE INSTALLED WHEN THE FINISHED FLOOR OF THE BUILDING IS BELOW THE UPSTREAM MANHOLE.

<b>WEST BAY</b>	
SANITARY DISTRICT	
SEWER RELIEF VALVE	
APPROVED BY:	
TIMOTHY CLAYTON	4/18/2005
DISTRICT MANAGER	DATE: