



DIA.	A	B	C MIN.
24"	24"	9"	19"
27"	27"	9"	17.5"
30"	30"	9"	16"
36"	36"	9.5"	13"

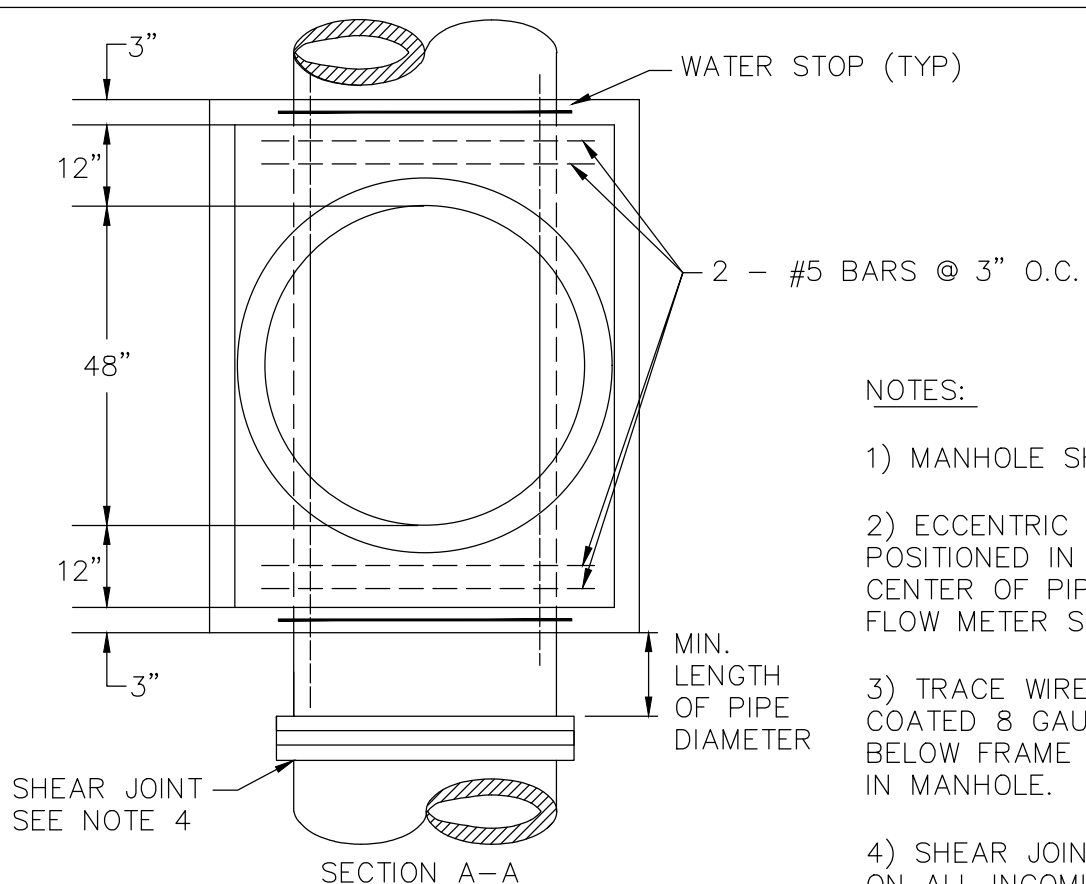

**NOTES:**

- 1) MANHOLE SHALL BE VACUUM TESTED.
- 2) ECCENTRIC CONE SHALL BE POSITIONED IN SUCH A MANNER OVER CENTER OF PIPE FOR INSTALLATION OF FLOW METER SENSOR BRACKET.
- 3) TRACE WIRE SHALL BE SOLID AND COATED 8 GAUGE COPPER WIRE PLACED BELOW FRAME WITH 3 FEET COILED UP IN MANHOLE.
- 4) SHEAR JOINT SHALL BE INSTALLED ON ALL INCOMING AND OUTGOING PIPES A DISTANCE OF ONE PIPE DIAMETER AWAY FROM THE OUTSIDE OF THE MANHOLE.

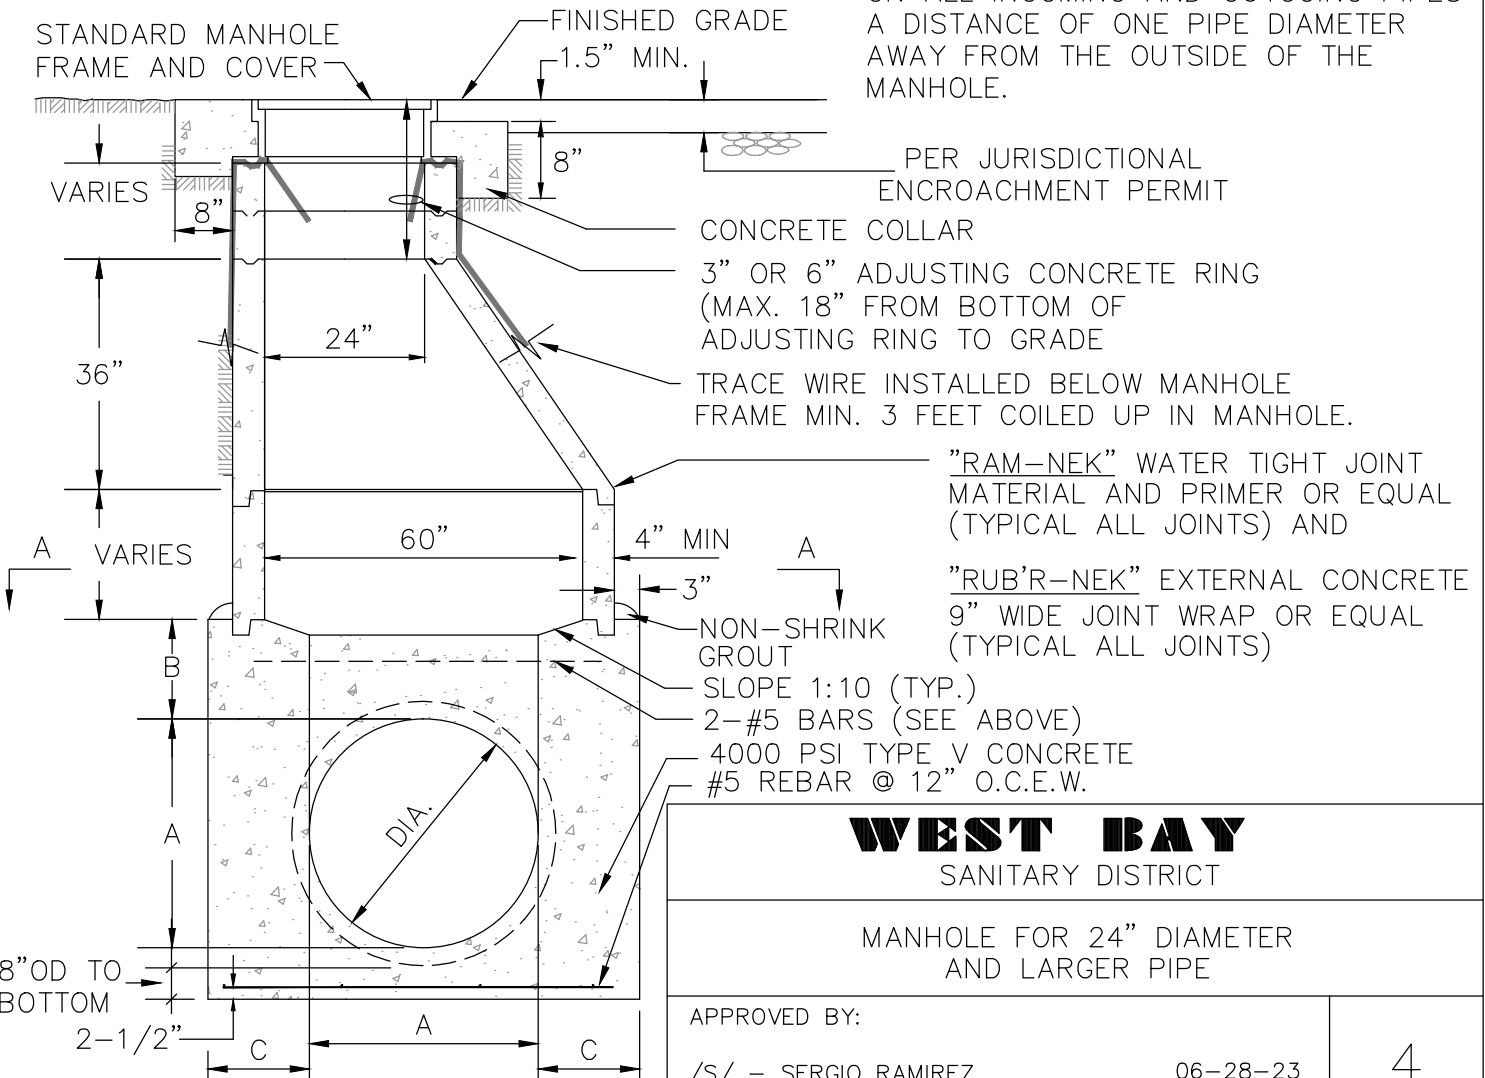

**WEST BAY**  
SANITARY DISTRICT

MANHOLE FOR 24" DIAMETER  
AND LARGER PIPE

APPROVED BY:

/S/ - SERGIO RAMIREZ  
GENERAL MANAGER

06-28-23  
DATE: