


REQUIRED CLEARANCE IN
12" MIN. MEASURED
FROM OUTSIDE TO PIPE
TO OUT SIDE OF PIPE.

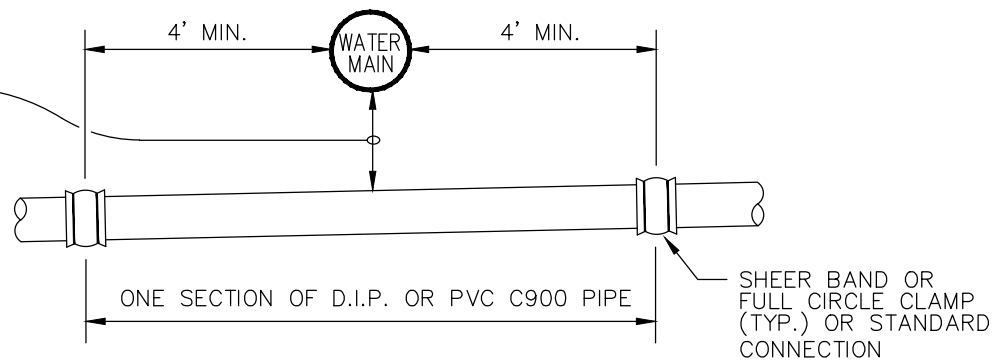

TYPICAL CROSSING UNDER WATER MAIN

NOTES

- 1) ALL WATER CROSSINGS SHALL CONFORM TO AMERICAN WATER WORKS ASSOCIATION (AWWA) STANDARDS.

WEST BAY
SANITARY DISTRICT

SANITARY SEWER WATER MAIN CROSSINGS

APPROVED BY:

/S/ - SERGIO RAMIREZ

GENERAL MANAGER

06-28-23

DATE:

22