| DIA. | A | B | C MIN. |
|---|---|---|---|
| 24" | 24" | 9" | 19" |
| 27" | 27" | 9" | 17.5" |
| 30" | 30" | 9" | 16" |
| 36" | 36" | 9.5" | 13" |

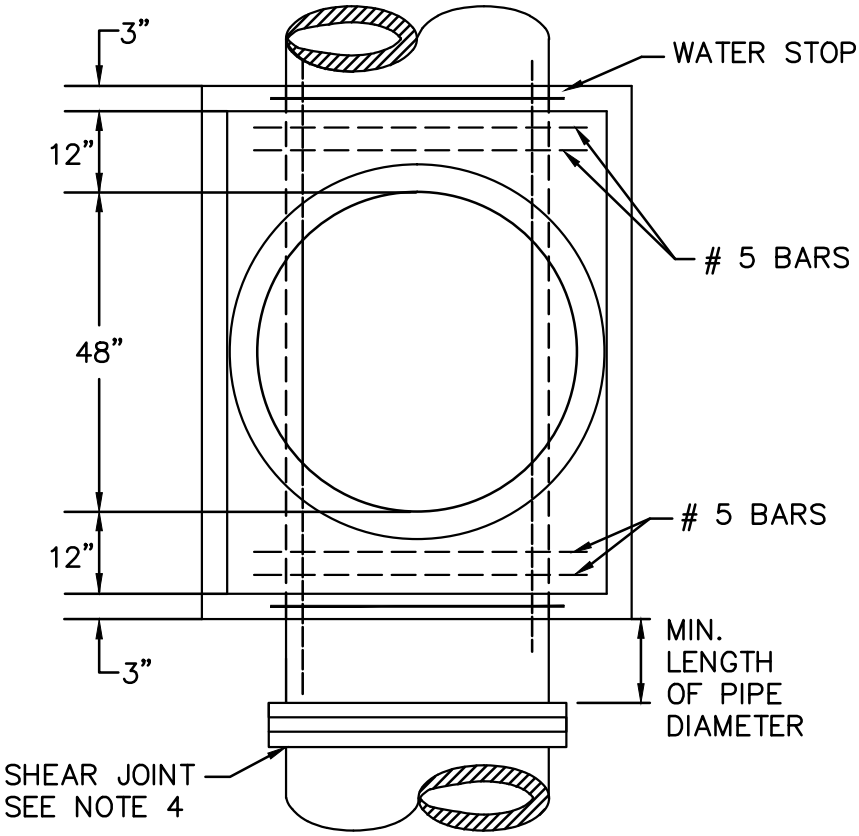


SECTION A–A

NOTES:

1) MANHOLE SHALL BE VACUUM TESTED.

2) ECCENTRIC CONE SHALL BE POSITIONED IN SUCH A MANNER OVER CENTER OF PIPE FOR INSTALLATION OF FLOW METER SENSOR BRACKET.

3) TRACE WIRE SHALL BE SOLID AND COATED 8 GAUGE COPPER WIRE PLACED 12" BELOW RIM WITH 3' COILED UP IN MANHOLE.

4) SHEAR JOINT SHALL BE INSTALLED ON ALL INCOMING AND OUTGOING PIPES A DISTANCE OF ONE PIPE DIAMETER AWAY FROM THE OUTSIDE OF THE MANHOLE.

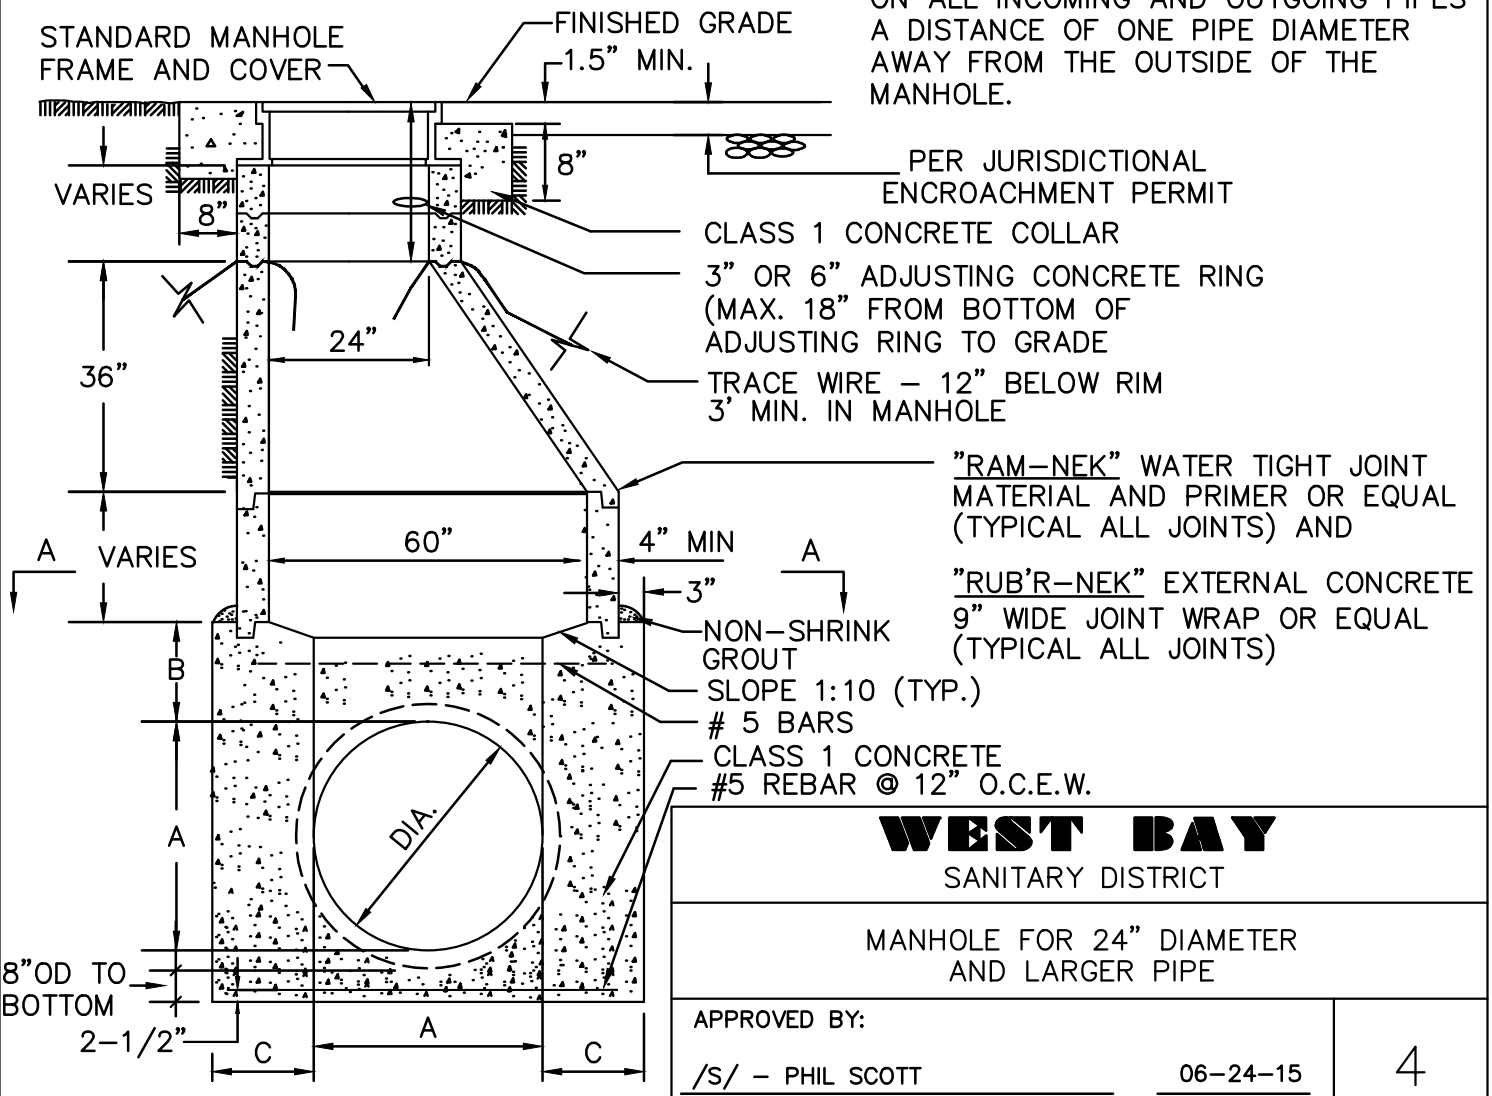


**WEST BAY**
SANITARY DISTRICT

MANHOLE FOR 24" DIAMETER AND LARGER PIPE

APPROVED BY:

/S/ – PHIL SCOTT
DISTRICT MANAGER

06–24–15
DATE:

4