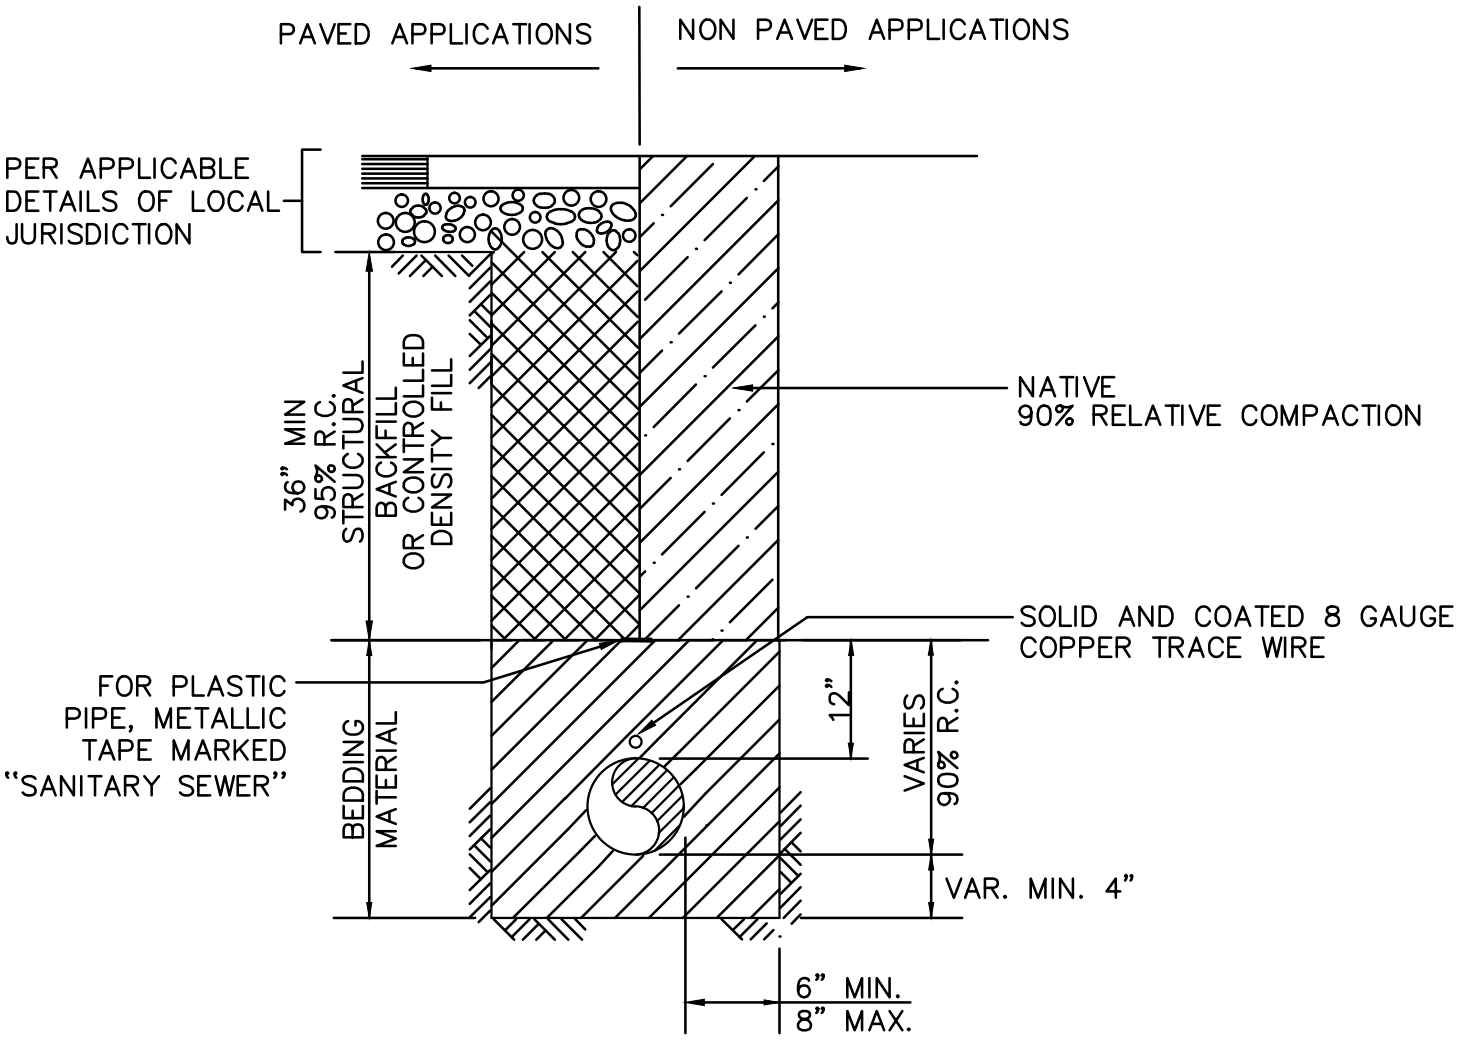

TYPICAL TRENCH SECTION

BEDDING MATERIAL

ANGULAR BEDDING MATERIAL REQUIREMENTS
PERCENT PASSING (CRUSHED DRAIN ROCK)

SIEVE SIZES	PERCENTAGE PASSING
1"	100
3/4"	90–100
3/8"	20–55
#4	0–10
#8	0–5

STRUCTURAL BACKFILL

STRUCTURAL BACKFILL REQUIREMENTS
PERCENT PASSING

SIEVE SIZES	PERCENTAGE PASSING
1–1/2"	100
3/4"	80–100
#4	30–60
#30	5–35
#200	0–12

WEST BAY
SANITARY DISTRICT

EXCAVATION, BACKFILL AND SURFACE RESTORATION

APPROVED BY:

/S/ – PHIL SCOTT — 06–24–15
DISTRICT MANAGER — DATE:

8