


TYPICAL LATERAL CROSSING OVER UTILITY (EXCLUDING WATER)

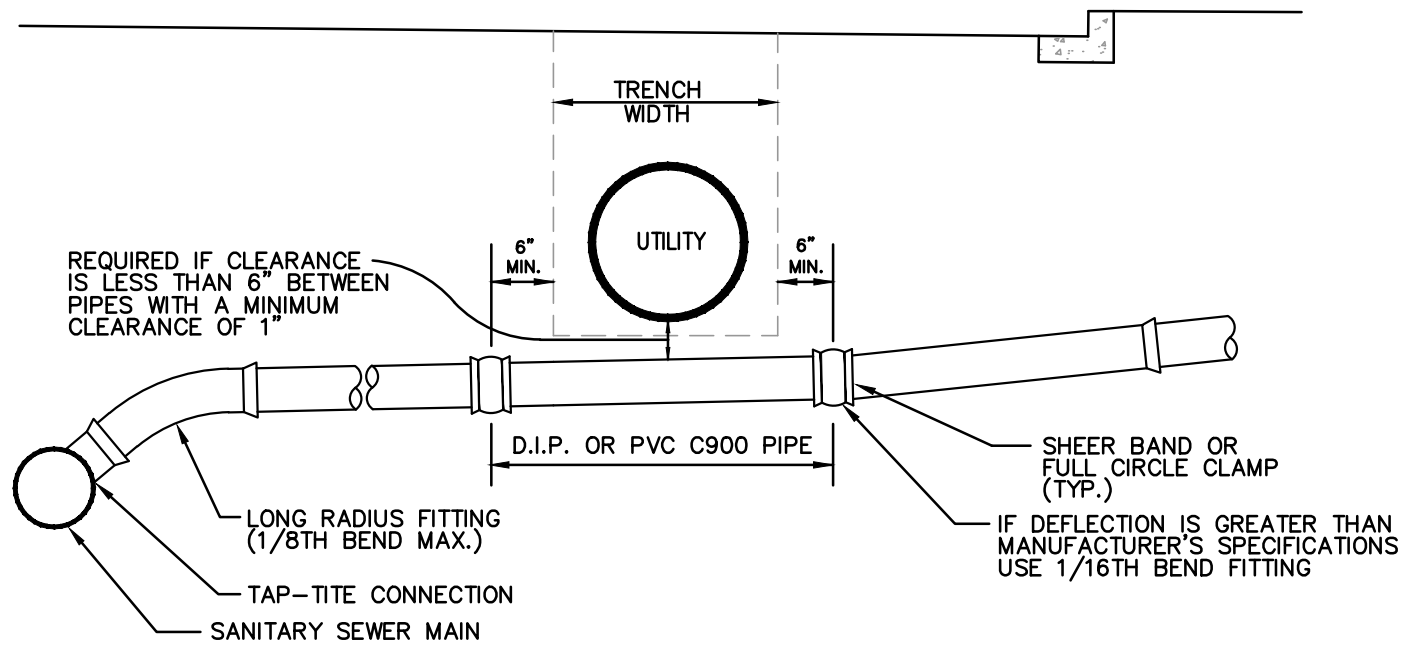

TYPICAL LATERAL CROSSING UNDER UTILITY (EXCLUDING WATER)

NOTE:

- 1) D.I.P. PIPE SHALL BE CLASS 50 OR 51, OR PVC PIPE SHALL BE C-900 DR 18.

WEST BAY SANITARY DISTRICT	
SANITARY SEWER LATERAL UTILITY CROSSINGS (EXCLUDING WATER)	
APPROVED BY: /S/ - PHIL SCOTT DISTRICT MANAGER	DATE: 06-24-15
23	