		Emergency By-Pass Equipment			
Item	Qty	Description	Total Footage	Equip. Location	Status
A	2	15’- Six Inch Discharge Hose w/cam locks			Inventory
B	3	6” Female to 4” male cam lock		Butler Bldg.	Inventory
C	12	6” Cam Lock Gaskets			Inventory
D	1	45 Degree, 6” Elbow w/ cam lock			Inventory
E	1	90 Degree, 6”elbow w/cam lock			Inventory
F	1	6” to 6” Cam Lock Coupler		Butler Bldg.	Inventory
G	5	6” Discharge Hose 50’ Each	250’	Butler Bldg.	Inventory
H	1	6” Strainer		Butler Bldg.	Inventory
I	2	6” Flanges to 6” Male Cam Lock		Butler Bldg.	Inventory
J	2	6”-6” Male to Male Cam Lock		Butler Bldg.	Inventory
K	1	6” Suction Hose 12’	12’	Butler Bldg.	Inventory
L	1	6” Suction Hose 10’	10’	Butler Bldg.	Inventory
M	12	4” Cam Lock Gaskets			Inventory
N	1	45 Degree, 4”Elbow w/ cam lock			Inventory
O	1	90 Degree, 4”elbow w/cam lock			Inventory
P	1	4”-4” Male to Male Cam Lock		Butler Bldg.	Inventory
Q	1	4” Strainer		Butler Bldg.	Inventory
R	2	6” Flange to 4” Male Cam Lock		Butler Bldg.	Inventory
S	2	5’- Four Inch Discharge Hose w/cam locks	10’		Inventory
T	2	10’- Four Inch Discharge Hose w/cam locks	20		Inventory
U	8	4” Discharge Hose 50’ each	400’	Butler Bldg.	Inventory
V	2	4” Suction hose 25’ each	50’	Butler Bldg.	Inventory
W	12	3” Cam Lock Gaskets			Inventory
X	1	3” Flange # 150 x 4” Female Cam Lock			Inventory
Y	1	3” Thread – 3” Male Cam Lock		Butler Bldg.	Inventory
Z	2	3” Discharge Hose 50’ each	100’	Butler Bldg.	Inventory
A1	1	3” Discharge Hose 25’ each	25	Butler Bldg.	Inventory
B1	1	6” Trash Pump Trailer Mounted		Butler Bldg.	Inventory
*B2	1	4” Trash Pump (Portable) Tsurumi		Butler Bldg.	Inventory
C1	*1*	**4” Trash Pump (Portable) Yamaha*	**Out of Service*	*Butler Bldg.*	**Inventory*
D1	1	3” BIBO Dewater Pump 110v		Butler Bldg.	Inventory
E1	1	230v 3Phase 25kw Generator w/4”BIBO Dewater Pump Trailer Mounted w/float control panel		Butler Bldg.	Inventory
F1	1	Yamaha 1kW Generator		Corp. Yard	Inventory
G1	1	Yamaha 6kW Generator		Corp. Yard	Inventory
H1	2	Tripod Lights		Corp. Yard	Inventory
I1	3	GFI 4-plug outlets		Corp. Yard	Inventory

HAMILTON-HENDERSON PUMP STATION
595 Hamilton Avenue x Willow Road
Menlo Park, (B-13)

Required equipment for by-passing this station, 6-inch trash pump, suction hose & discharge hose (6” By-Pass)

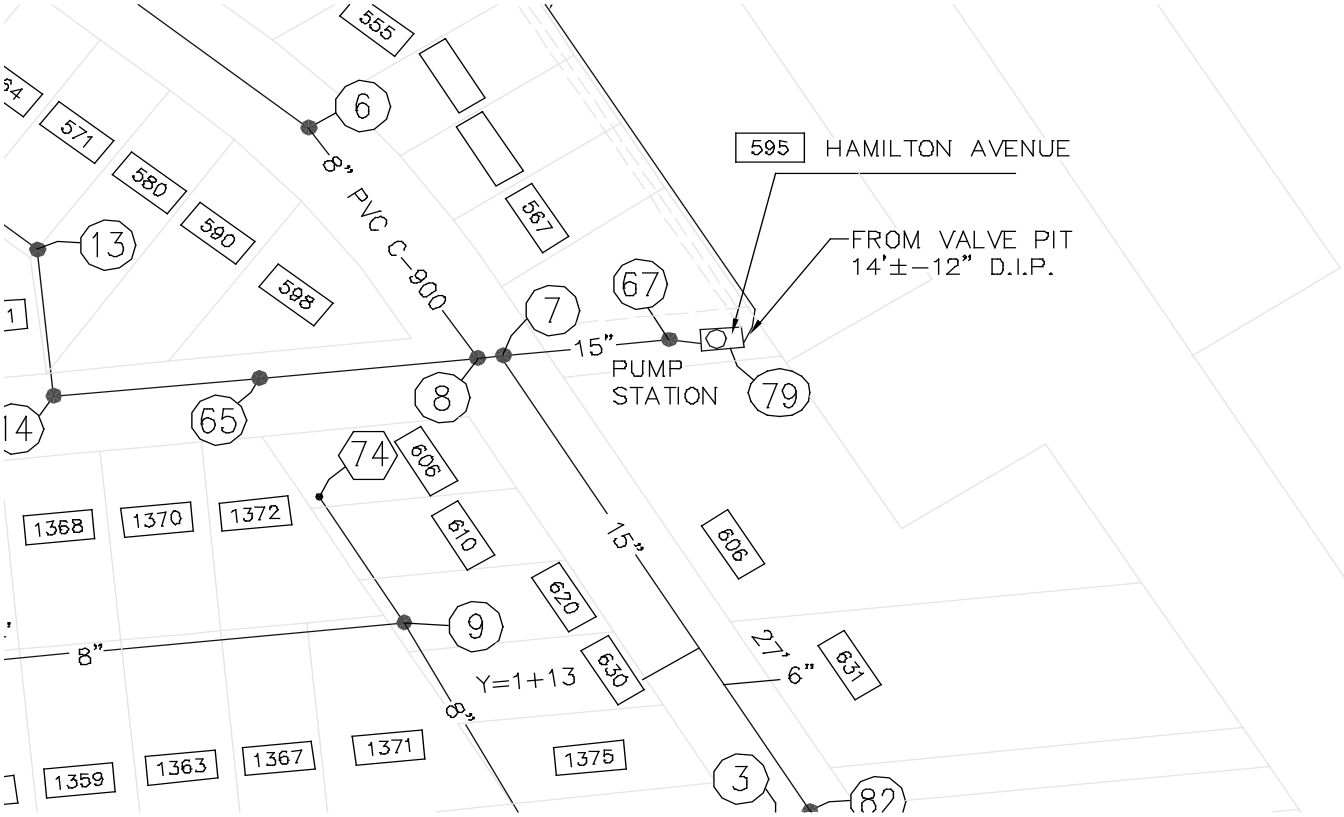

MENLO INDUSTRIAL PUMP STATION
1002 Hamilton Court x Hamilton Avenue
Menlo Park, (B-12)

Required equipment for by-passing this station, 6-inch trash pump, **6”** suction hose & **4”** discharge hose, 2-6”X4” female to male camlocks. (4” By-Pass)

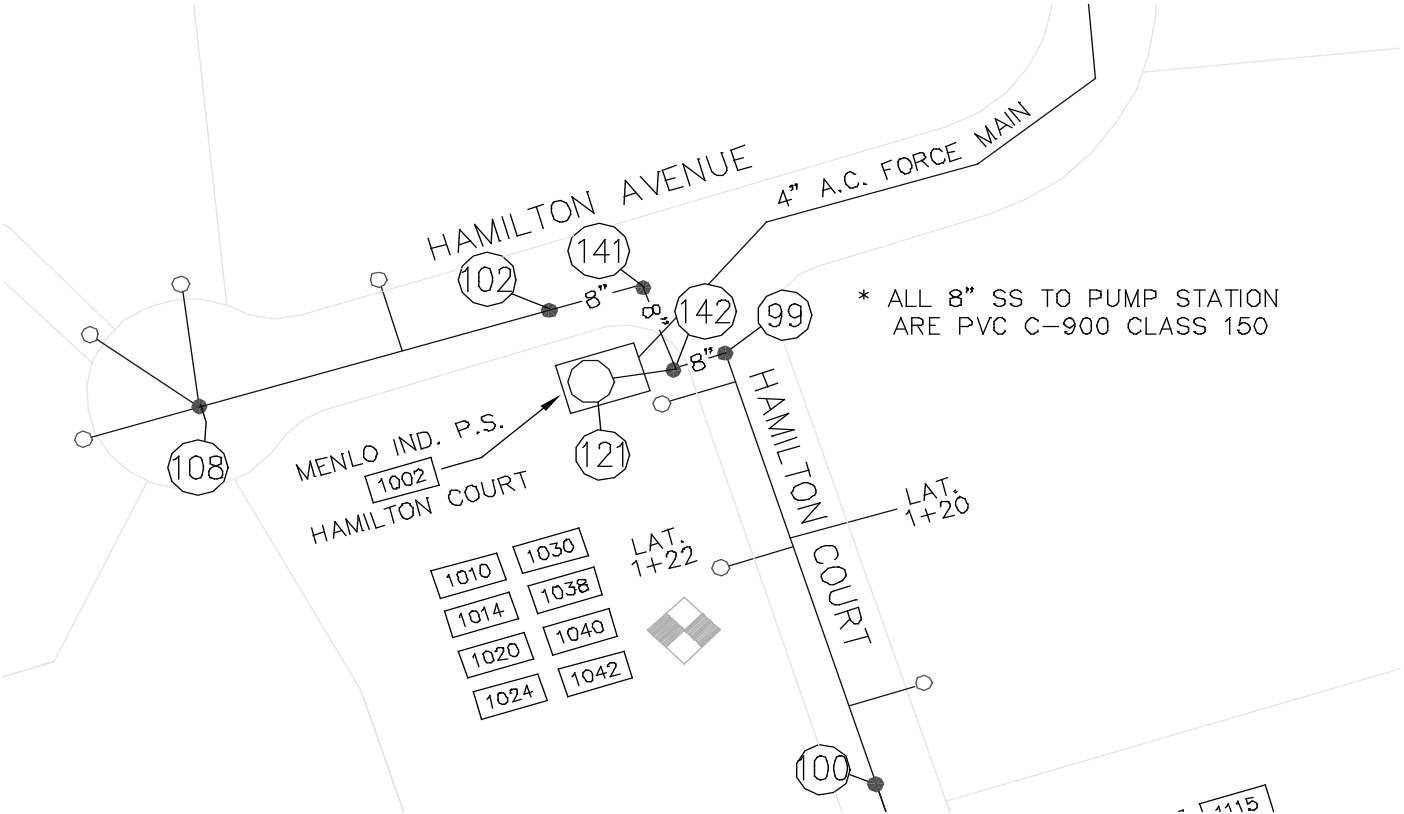

WILLOW ROAD PUMP STATION
1298 Willow Road x O'Brien Drive
Menlo Park, (B-12)

Required equipment for by-passing this station, 6-inch trash pump, 6"suction & discharge hose (6" By-Pass).

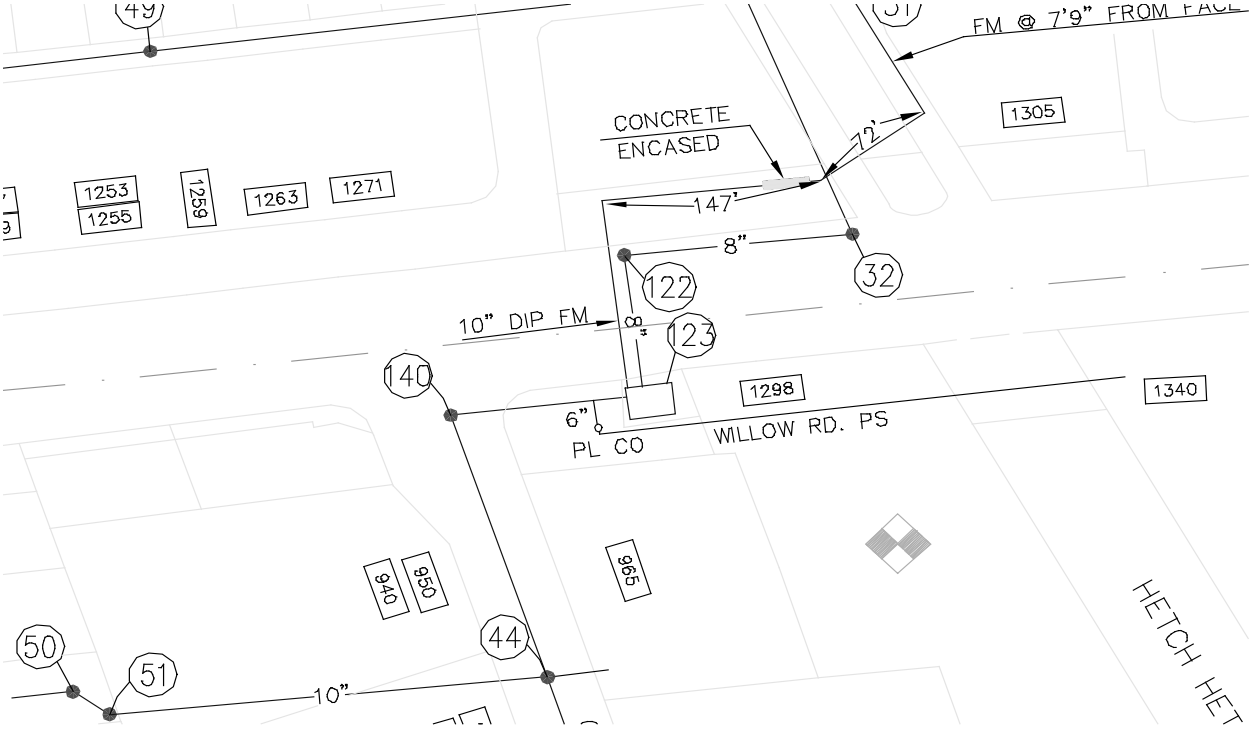

UNIVERSITY PUMP STATION
1595 O'Brien Drive x University Avenue
East Palo Alto, (B-11)

Required equipment for by-passing this station: <u>6-inch trash pump</u>, **6"** suction hose & **6"** discharge hose.

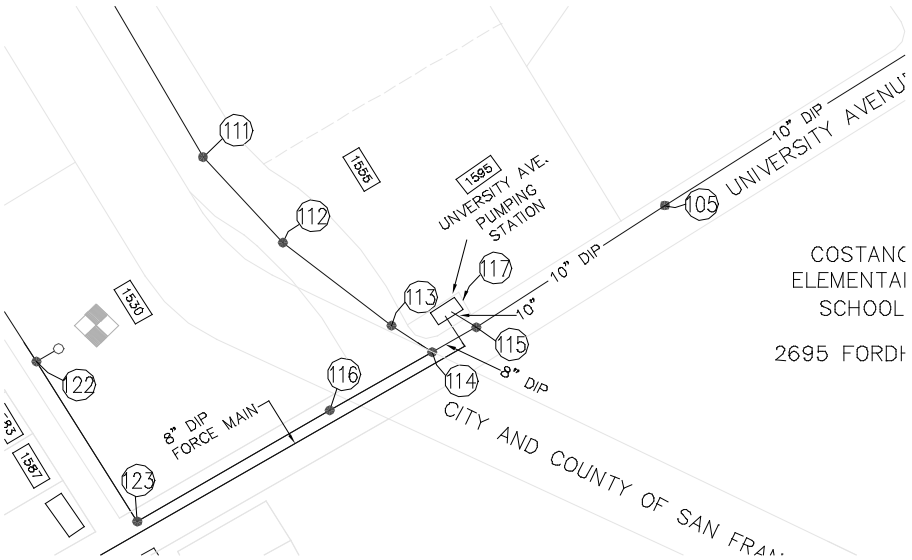

ILLINOIS PUMP STAION
335 Demeter Street x Bay Road
East Palo Alto, (A-10)

Required equipment for by-passing this station: 6-inch trash pump, 6”suction hose & discharge hose (6” By-Pass).

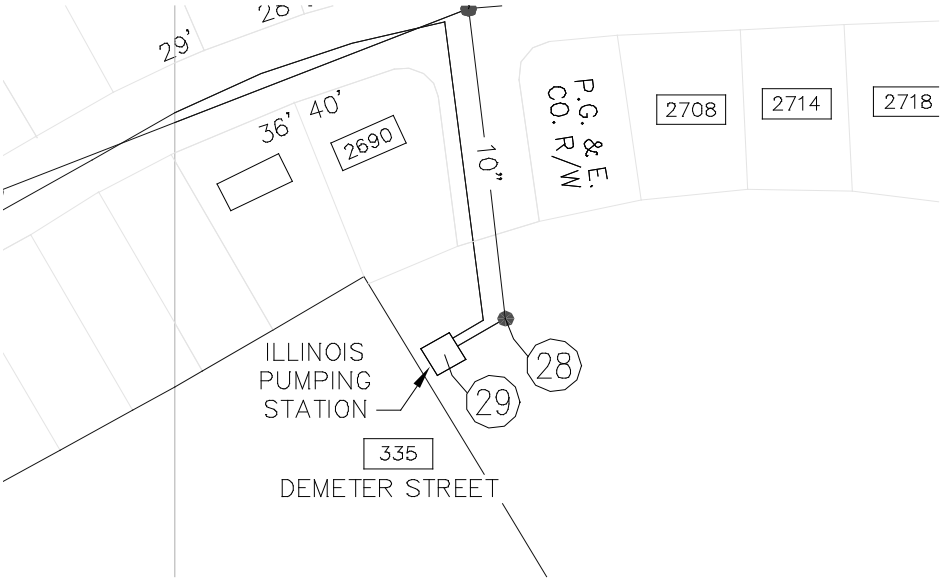

VINTAGE OAKS-I
PUMP STATION
100 Seminary Road x Middlefield Road
Menlo Park, (D-12)

Required equipment for by-passing this station, 6-inch trash pump, 2- 6”X4” camlocks fitting, **6”** suction hose & **4”** discharge hose (4” By-Pass).

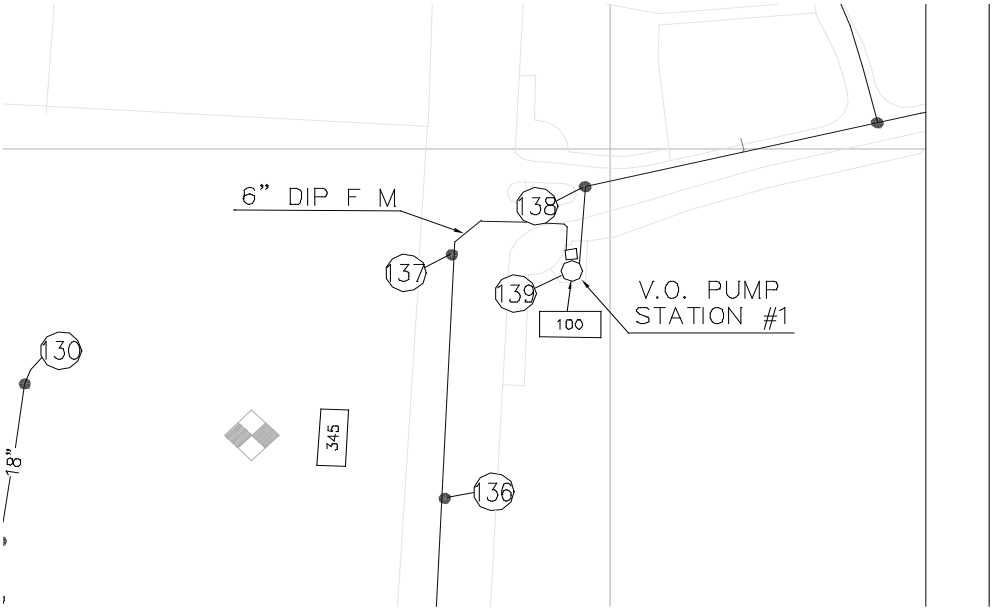

VINTAGE OAKS-II
PUMP STATION
190 Seminary Road x Middlefield Road
Menlo Park, (E-12)

Required equipment for by-passing this station, 6-inch trash pump, 2- 6”X4” camlocks fittings **6**”suction hose & **4”** discharge hose (4” By-Pass).

130

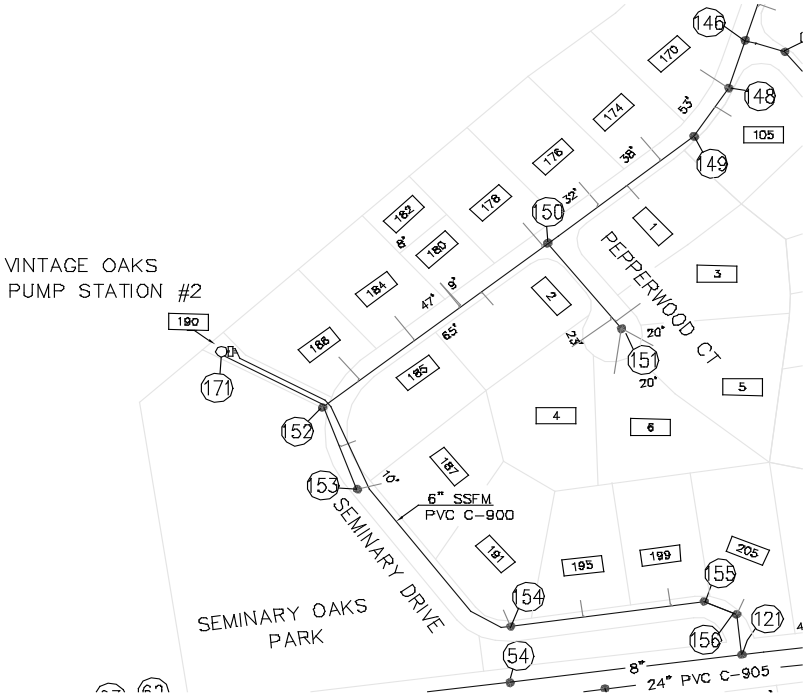

STOWE LANE LIFT STATION
17 Stowe Lane x Alpine Road
Menlo Park, (I-12)

Required equipment for by-passing this station, 6-inch trash pump, 6”suction hose & discharge hose. (6” By-Pass).

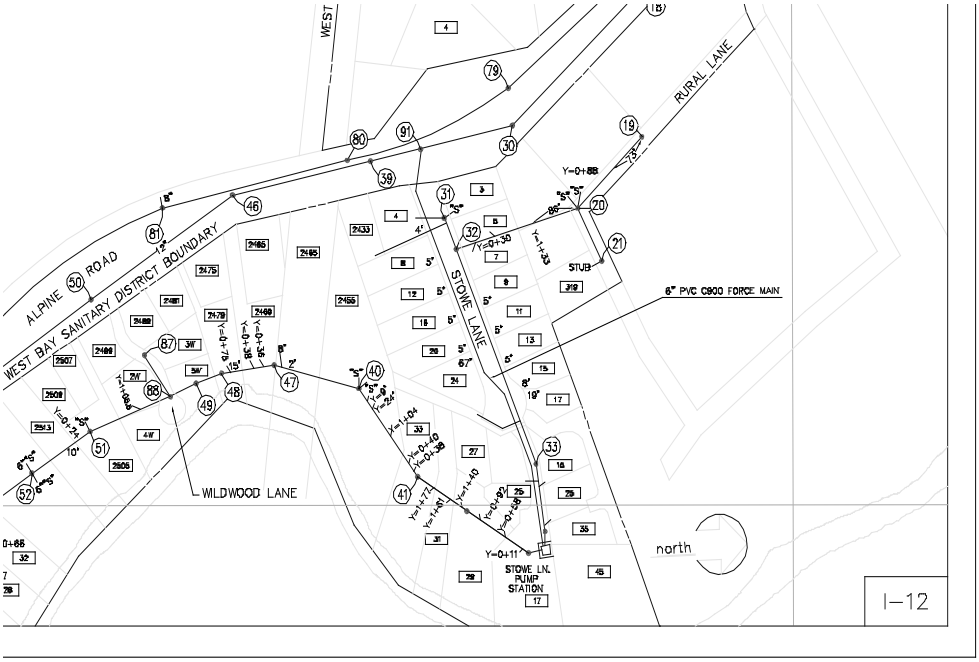

LOS TRANCOS LIFT STATION
63 Los Trancos Road x Alpine Road
Portola Valley, CA (M-9)

Required equipment for by-passing this station, 6-inch trash pump, 2- 6”X4” camlocks fittings, **6”** suction hose & **4”** discharge hose (4” By-Pass).

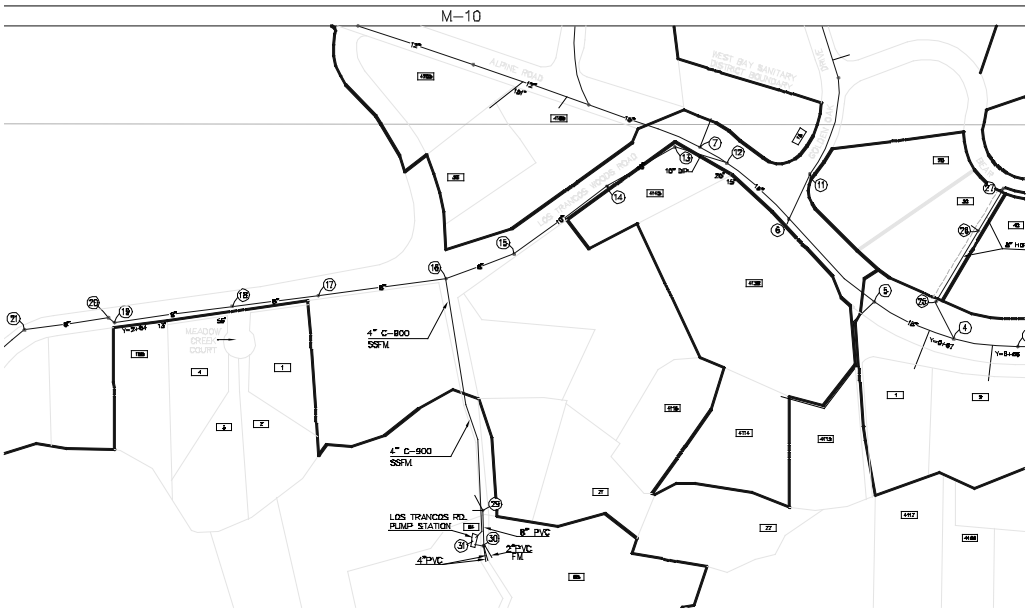

CORTE MADERA LIFT STATION
401 Portola Road x Alpine Road
Portola Valley (N-11)

Required equipment for by-passing this station, 6-inch trash pump, 6”suction hose & discharge hose (6” By-Pass).

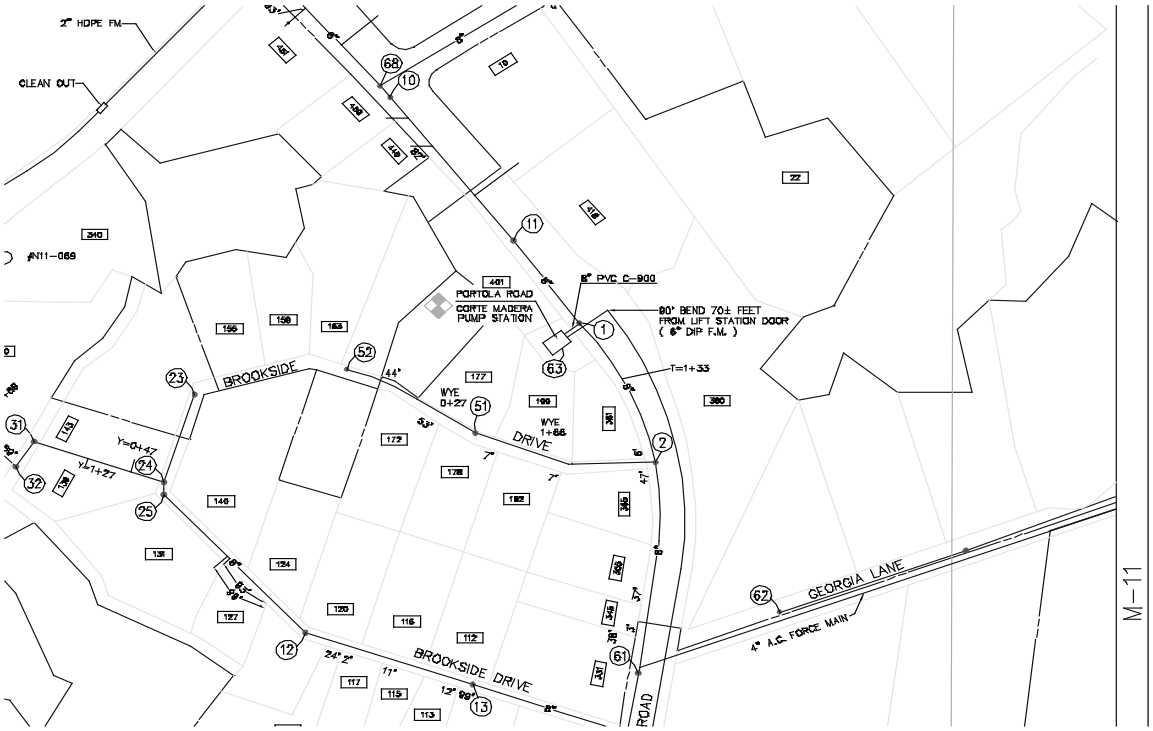

SAUSAL VISTA LIFT STATION
250 Georgia Lane x Portola Road
Portola Valley (N-11)

Required equipment for by-passing this station, 6-inch trash pump, 2- 6”X4” camlocks fittings, **6”** suction hose & **4”** discharge hose (4” By-Pass).

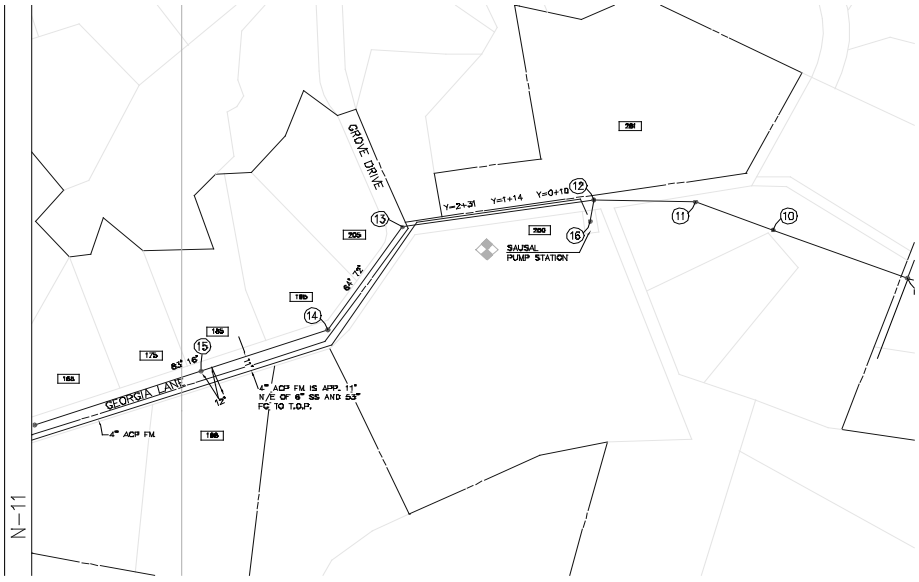

VILLAGE SQUARE LIFT STATION
884 Portola Road x Alpine Road
Portola Valley (M-13)

Required equipment for by-passing this station, <u>Truck #205 (Vactor)</u>